



Models beginning with 1K, 1N, 1O, 2K, 2N and 2O

Series 1000 and Series 2000



Product Description
Technical Specifications
Installation Instructions



1. Product Description	3
1.1 General Description.....	3
1.2 Meter Features.....	3
1.3 Meter Certifications	3
1.4 Physical Description	3
2. Technical Specifications	6
2.1 Electrical Specifications.....	6
2.2 Input/Output Connections.....	6
2.3 Display Specifications.....	10
2.3.1 General Display Information.....	10
2.3.2 Resetting the Peak Demand.....	10
3. Installation Instructions.....	11
3.1 Explanation of Warning Symbols	11
3.2 Safety Precautions.....	11
3.3 Preparation	12
3.4 List of Materials.....	12
3.5 Mounting the Enclosure	12
3.5.1 Mounting Location	12
3.5.2 Drilling Conduit Holes.....	13
3.5.3 Mounting Procedure and Conduit Installation.....	13
3.6 Installation of Voltage Lines.....	14
3.7 Variations and Installation of Current Transformers	15
General Requirements.....	15
3.8 Testing the Installation.....	20
3.9 Securing the Enclosure.....	20
4. Maintenance.....	21
5. Troubleshooting/FAQ.....	21
6. Contact Information.....	22

List of Figures

Figure 1: Steel Enclosure Dimensions.....4
Figure 2: Plastic Enclosure Dimenstions.....5
Figure 3: Series 1000/2000 I/O Connections.....7
Figure 4: Mounting the Enclosure.....14
Figure 5: Leviton Solid Core CTs.....15
Figure 6: Leviton Split Core CTs.....16
Figure 7: 1-phase, 2-wire Hook up Diagram.....17
Figure 8: 1 or 2-phase, 3-wire Hookup Diagram.....18
Figure 9: 3-phase, 4-wire WYE Hookup Diagram.....19

List of Tables

Table 1: Series 1000 Electrical Specfication..... 6
Table 2: Series 1000 Electrical Specfication.....7
Table 3: I/O connections and LEDs.....9

1. Product Description

1.1 General Description

The Leviton Series 1000 and 2000 meters are self-powered; current transformer (CT) rated electronic kilowatt-hour (kWh) meters designed for permanent connection to an electrical service. Series 1000 meters are designed for 1- phase, 2-wire and 1 or 2-phase, 3-wire services, whereas Series 2000 meters are designed for 3-phase, 4-wire services. This guide is for use with individual Series 1000 and 2000 units.

1.2 Meter Features

- Revenue-grade accuracy with solid-core or easy to install split core CTs
- Built in LCD that display or external mechanical counter
- Multiple load monitoring with a single meter
- AMR compatible isolated pulse outputs
- Reverse-phase LED indicator
- 5-year warranty

1.3 Meter Certifications

- UL Listed in the US and Canada
- Conforms to accuracy requirements set forth in ANSI C12.10

1.4 Physical Description

Single Series 1000 and Series 2000 meters are available in two enclosures:

1. Industrial grade JIC steel enclosures for indoor installations shown in Figure 1

2. Plastic NEMA 4X enclosures, shown in Figure 2

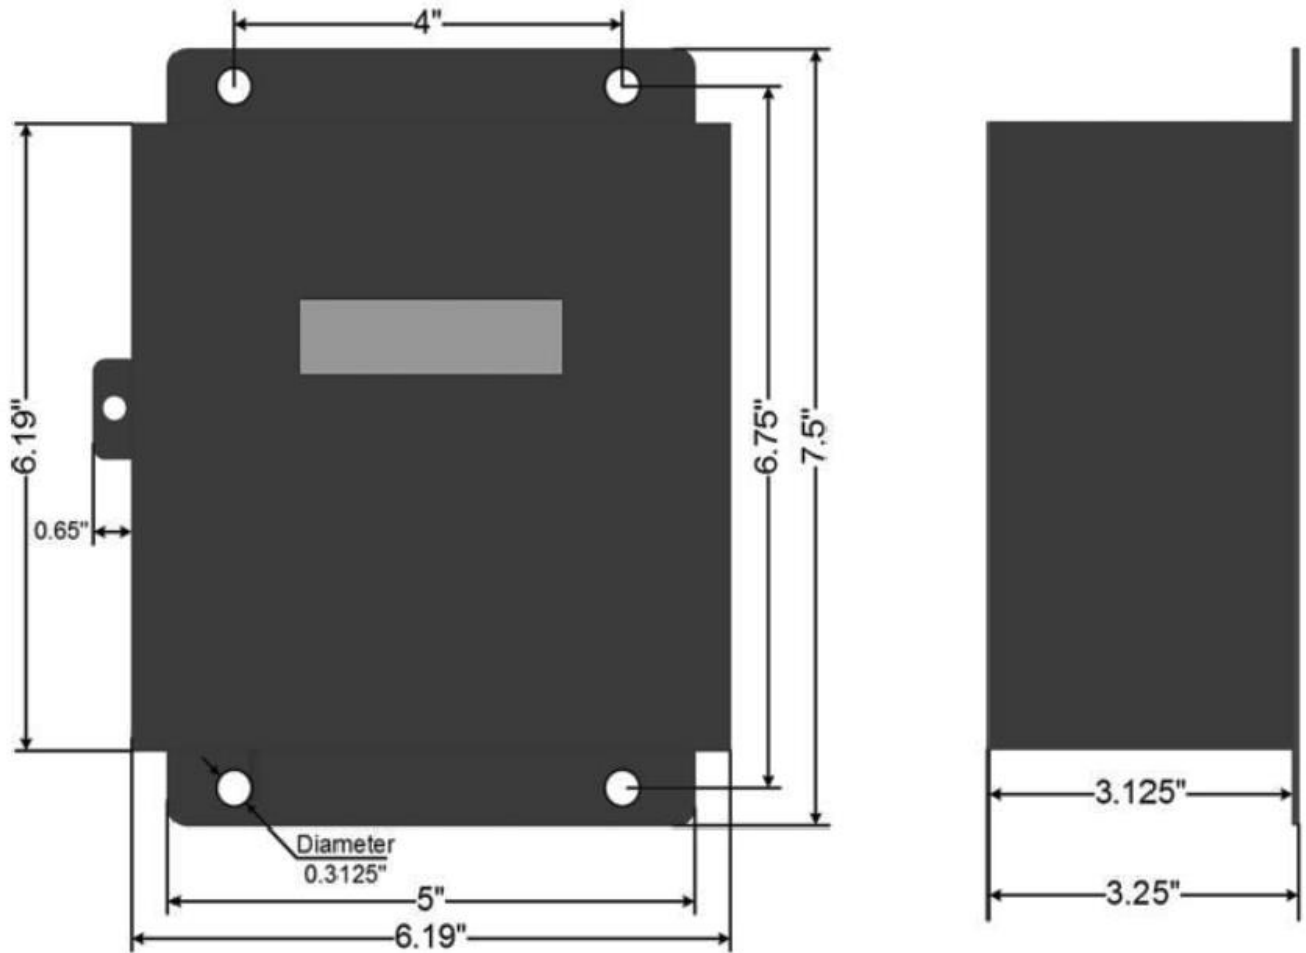


Figure 1: Steel enclosure dimensions

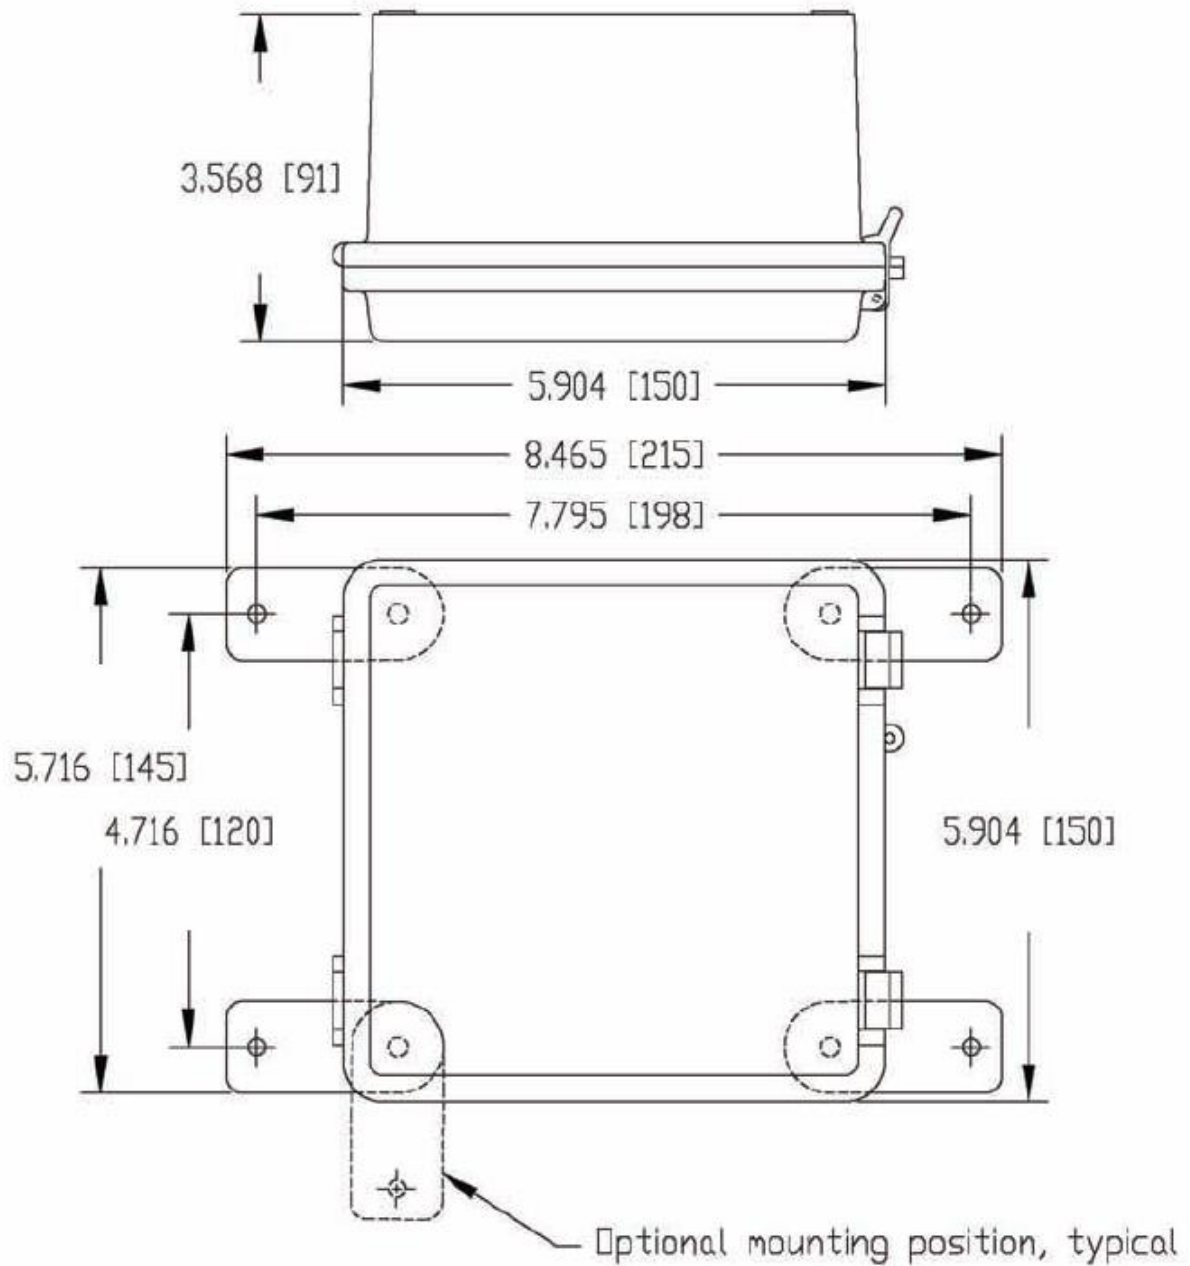


Figure 2: Plastic enclosure dimensions

2. Technical Specifications

2.1 Electrical Specifications

Series 1000 and Series 2000 Meters fall under UL Circuit Category III: a device for measurements performed in the building installation. The electrical and environmental specifications for Series 1000 and Series 2000 meters are given in Table 1 and Table 2 below:

Series 1000 Electrical Specifications

Input Configurations	1 Phase, 2 wire (120 V or 277 V)	1 or 2 Phase, 3 Wire (120/208, 120/240 or 277/480 V)
Supply Voltage Range (Line to Neutral)	102-138 VAC 235-320 VAC	102-138 VAC 235-320 VAC
Maximum Input Power	7 VA	7 VA
Maximum Rated Current*	<u>Primary</u> : Max. Operating Current + 10% <u>Secondary</u> : 0.12 A	<u>Primary</u> : Max. Operating Current + 10% <u>Secondary</u> : 0.12 A
Line Frequency	50-60 Hz	50-60 Hz
Power Factor Range	0.5 to 1.0 leading or lagging	0.5 to 1.0 leading or lagging
Accuracy ¹	+/- 0.5% of registration @ 1.0pf, 1% to 100% of rated current +/- 0.75% of registration @ 0.5pf, 1% to 100% of rated current	+/- 0.5% of registration @ 1.0pf, 1% to 100% of rated current +/- 0.75% of registration @ 0.5pf, 1% to 100% of rated current
Meter Operating Temperature	-30 to +60 degrees C	-30 to +60 degrees C
Display Operating Temperature	-20 to +50 degrees C	-20 to +50 degrees C
Rated Pollution Degree ²	2	2
Rated Relative Humidity	80%	80%
Terminal Blocks: Voltage Terminal: CT and I/O Terminal:	12 in-lb of torque maximum 4.4 in-lb of torque maximum	12 in-lb of torque maximum 4.4 in-lb of torque maximum

Table 1: Series 1000 electrical specifications

¹Accuracy based on Leviton solid core current transformers (included), with 100 mA secondary output. Meter input burden resistance at 2 Ohms

²Pollution Degree 2: Normally only non-conductive pollution occurs. Occasionally, however, a temporary conductivity caused by condensation must be expected.

Series 2000 Electrical Specifications

Input Configurations	3 Phase, 4 Wire Grounded Delta (120/208 V)	3 Phase, 4 Wire Wye (120/208 or 277/480V)
Supply Voltage Range (Line to Neutral)	Line 1 and Line 2: 102-138 VAC Line 3: 175-240 VAC	102-138 VAC 235-320 VAC 295-400 VAC
Maximum Input Power	7 VA	7 VA
Maximum Rated Current*	<u>Primary</u> : Max. Operating Current + 10% <u>Secondary</u> : 0.12 A	<u>Primary</u> : Operating Current + 10% <u>Secondary</u> : 0.12 A
Line Frequency	60 Hz	60 Hz
Power Factor Range	0.5 to 1.0 leading or lagging	0.5 to 1.0 leading or lagging
Accuracy ¹	+/- 0.5% of registration @ 1.0pf, 1% to 100% of rated current +/- 0.75% of registration @ 0.5pf, 1% to 100% of rated current	+/- 0.5% of registration @ 1.0pf, 1% to 100% of rated current +/- 0.75% of registration @ 0.5pf, 1% to 100% of rated current
Meter Operating Temperature	-30 to +60 degrees C	-30 to +60 degrees C
Display Operating Temperature	-20 to +50 degrees C	-20 to +50 degrees C
Rated Pollution Degree ²	2	2
Rated Relative Humidity	80%	80%
Terminal Blocks: Voltage Terminal: CT and I/O Terminal:	12 in-lb of torque maximum 4.4 in-lb of torque maximum	12 in-lb of torque maximum 4.4 in-lb of torque maximum

Table 2: Series 2000 electrical specifications

¹Accuracy based on Leviton solid core current transformers (included), with 100 mA secondary output. Meter input burden resistance at 2 Ohms

²Pollution Degree 2: Normally only non-conductive pollution occurs. Occasionally, however, a temporary conductivity caused by condensation must be expected.

2.2 Input/Output Connections and User Display

The input and output terminals for Series 1000 and Series 2000 meters are shown below in Figure 3. For hookup diagrams and wiring information refer to section 3.

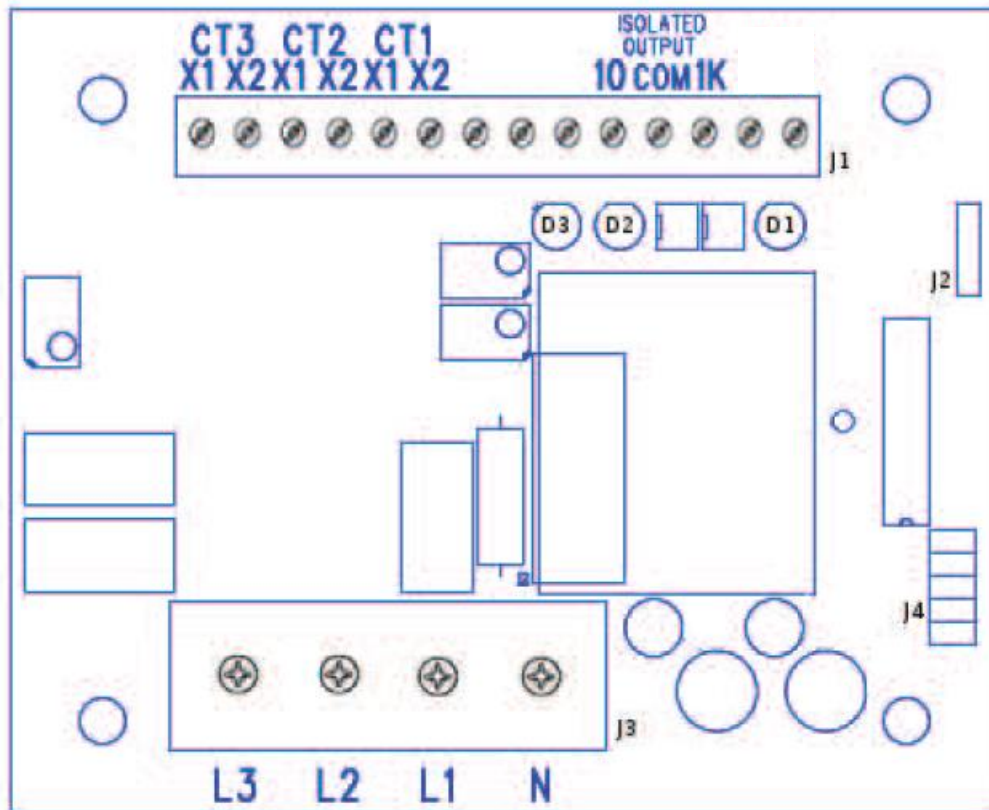


Figure 3: Series 1000/2000 I/O Connections

<u>Voltage Inputs (J3)</u>	<u>Description</u>
L3	Voltage input Line 3 (3-phase models only. High leg connection on grounded Delta distributions)
L2	Voltage input, Line 2 (3-wire and 4-wire models only)
L1	Voltage input, Line 1
N	Neutral input
<u>CT Inputs (J1, Left Side)</u>	
CT3 : X1	Current Transformer input, CT3. Colored wire of CT3 (3-phase models only)

CT3 : X2	Current Transformer input, CT3. White wire of CT3 (3-phase models only)
CT2 : X1	Current Transformer input, CT2. Colored wire of CT2 (3-wire and 4-wire models only)
CT2 : X2	Current Transformer input, CT2. White wire of CT2 (3-wire and 4-wire models only)
CT1 : X1	Current Transformer input, CT1. Black or Wh/Blk (striped) wire of CT1
CT1 : X2	Current Transformer input, CT1. White wire of CT1
Outputs (J1, Right Side)	
10, Isolated Output (10 Wh/P, Kh = 10)	Isolated pulse output: 5 wathours on, 5 wathours off, referenced to ISOL COM
COM, Isolated Output	Isolated common for 10/1000 isolated outputs
1K, Isolated Output (1 kWh/P, Kh=1000)	Isolated pulse output: 500 wathours on, 500 wathours off, referenced to ISOL COM

LED Indicators	
1 kWh LED (D3 - Green)	50% duty cycle (at constant load) LED with a pulse rate of 1 kWh per on/off cycle (500 Wh on, 500 Wh off). In the absence of a significant load, the LED could be on or off.
10 Wh LED (D2 - Green)	50% duty cycle (at constant load) LED with a pulse rate of 10 Wh per on/off cycle (5 Wh on, 5 Wh off). In the absence of a significant load, the LED could be on or off.
Reverse Phase LED (D1 - Red)	Illuminates when a problem with meter phasing exists. In the absence of a significant load, the LED could be on or off. See section 3.7 for CT installation instructions.

Table 3: I/O connections and LEDs

2.3 Display Specifications

2.3.1 General Display Information

Series 1000 and 2000 meters are available with or without a demand feature. Meter models without the demand option display only total active energy, measured in kilowatt-hours (1 kWh resolution, non-resettable). The liquid crystal display (LCD) tests all LCD segments by simultaneously activating them for 1 second every 18 seconds. The test is used to determine if an LCD segment isn't working, in which case the displayed values would appear incorrectly. For meters with the demand option, three quantities are displayed one at a time, for six seconds each, as follows:

- Total Active Energy, in kWh (1 kWh resolution, cumulative, non-resettable)
- Instantaneous Demand, in Kilowatts (last 5 minute average, 1/100 kW resolution)
- Peak Demand: Kilowatts (15 minute rolling demand interval, 1/100 kW resolution)

A dot in the LCD aligns with an arrow on the display label to differentiate between instantaneous and peak demand. After displaying peak demand and before displaying total energy, the meter tests the LCD by activating all segments simultaneously for one second.

2.3.2 Resetting the Peak Demand

The stored peak demand is reset using the key switch. A demand reset command will only be recognized during the period when the peak demand is displayed on the LCD. In order to reset the demand, a pulse must be generated by turning the key switch from locked position (arrow up) to the right and then back to the original position. This back and forth transition triggers a demand reset. The maximum transition period is one second. Multiple key switch transitions during the peak demand display interval may be required to reset peak demand.

3. Installation Instructions

The following section contains installation and wiring instructions for the Leviton Series 2000 multiple meter unit. If technical assistance is required at any point during the installation, contact information can be found at the end of this manual. Leviton is not responsible for damage to the meter caused by incorrect wiring.

3.1. Explanation of Warning Symbols



Indicates the need to consult the operation manual due to the presence of a potential risk.





Indicates the presence of electric shock hazards. Prior to proceeding, de-energize the circuit and consult the operation manual.



Indicates that the equipment is protected throughout by double insulation.

3.2 Safety Precautions

 **WARNING** 

- **Installation of electric meters requires working with possibly hazardous voltages. These instructions are meant to be a supplement to aid trained, qualified professionals.**
- **Turn off all power supplying the equipment before performing any wiring operations. Use a properly rated voltage sensing device to confirm power is off.**
- **Bonding is not automatic for metal conduit connections; separate bonding is to be provided.**
- **Installations should be done in accordance with local codes and current National Electric Code requirements.**
- **Equipment used in a manner not specified by this document impairs the protection provided by the equipment.**

Failure to follow these warnings could result in serious injury or death.

3.3 Preparation

1. Verify the model number and electrical specifications of the device being installed to confirm they are appropriate for the intended electrical service (see Section 2).
2. Consult local codes for any possible permits or inspections required before beginning electrical work.
3. Ensure the conduit for the installation is appropriate for the intended application. UL Type 4x conduit and conduit fittings required for outdoor applications.
4. Make sure all tools to be used during installation have proper insulation ratings.
5. Look at the Meter and inside the electrical panel for possible exposed wire, broken wire, damaged components or loose connections.

3.4 List of Materials

- Series 1000 or Series 2000 meter, enclosure and associated mounting materials
- Line 1, Line 2, Line 3 and Neutral hook-up wires as needed for the electrical service.
- Wires must be 18 AWG or larger and insulated for 600 VAC min.
- Current Transformers (CTs): This product is designed for use with Leviton CTs
- Conduit and fittings as appropriate. UL Type 4X conduit and fittings must be used for outdoor applications to maintain the rating of the installation.

3.5 Mounting the Enclosure

3.5.1 Selecting a Mounting Location

- Series 1000 and 2000 meters require a switch or circuit breaker as part of the building installation.
- The switch or circuit breaker must be marked as the disconnecting device for the meter.
- It is recommended that the enclosure be mounted near the disconnecting device in an area with adequate ventilation.
- The enclosure should not be positioned in a manner that makes it difficult to operate the disconnecting device.
- Ensure that the CT and voltage lead lengths (and conduit lengths) are capable of reaching the enclosure from the load center.
- If a suitable mounting location near the load center cannot be found, additional in-line fuses or circuit breaker may be required in accordance with NEC regulations.

3.5.2 Conduit Openings

Steel Enclosure

The Series 1000 and 2000 steel enclosure comes with a 1 1/16” knockout (3/4” conduit) on the bottom of the enclosure, and a 7/8” knockout (1/2” conduit) on top of the enclosure. To remove a knockout, use a flathead screwdriver (or other rigid device) to puncture the indentations first, and then pry off and discard the knockout.

Outdoor Enclosure

The bottom panel and lower half of the side panels work best for conduit opening locations in outdoor single meter enclosures. Select the location that makes wire installation easiest for the given environment. If the side panels are used, holes should be centered approximately half an inch from the bottom of the enclosure. Hole sizes must be appropriate to fittings, and large enough to fit all voltage and CT wiring (4-10 18 AWG min. wires insulated for 600 V min.). Care should be exercised to keep drill bit away from components inside the enclosure. **UL Type 4X conduit and fittings must be used in order to maintain the outdoor rating of the enclosure.**

3.5.3 Mounting Procedure and Conduit Installation

1. For outdoor enclosures, attach the mounting brackets to the back of the enclosure with the four provided screws as shown in Figure 4.
2. Fasten the enclosure to the selected surface using the provided mounting holes (steel enclosure) or mounting brackets (plastic enclosure).
3. Verify that the enclosure is not loose and that all connections are secure.
4. Attach the conduit between enclosure and load center, routing wires as necessary for later use.
5. Make sure the conduit fittings are aligned properly and tightened securely to prevent moisture from entering the enclosure (outdoor applications).

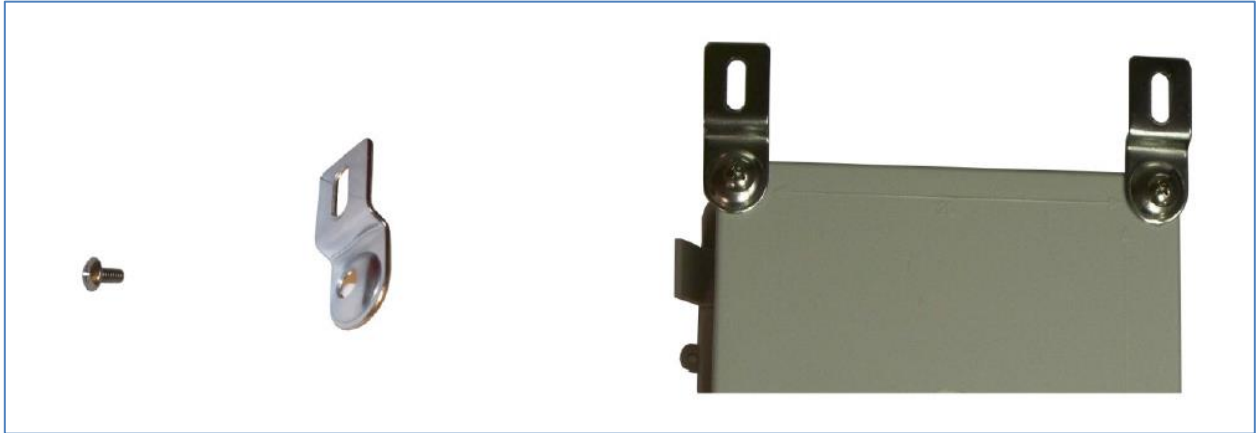


Figure 4: Mounting the Enclosure

3.6 Installation of Voltage Lines



Check to make sure service is disconnected before any connections are made.



Voltage connections must be made in accordance with NEC Section 240 and all other local electrical code requirements.

1. Connect 18 AWG min., 600 V min. insulated wiring for Line voltages and Neutral to the appropriate locations in the breaker panel, in accordance with all national and local electrical codes.
2. Route wires through the conduit if not already done.
3. Trim the wire to the appropriate length to avoid coils of excess wiring.
4. Strip wiring to approximately .300 inches if needed and connect to the appropriate terminals. Wires should be tightened so that they are held snugly in place, but do not to over-tighten, as this may compress and weaken the conductor.

3.7 Installation of Current Transformers



To reduce risk of electric shock, always open or disconnect the circuit from the power distribution system of a building before installing or servicing current transformers.



In accordance with NEC, CTs may not be installed in any panel board where they exceed 75% of the wiring space of any cross-sectional area.

General Requirements:

- Splices on the CT leads must be within the meter enclosure, not inside the conduit. Leviton provided CT leads are 24 inches minimum. Wire insulation should be stripped so that the bare conductor length that connects to the meter terminal block does not exceed 0.300 inches.
- CTs should be securely fastened such that they will not slide down to live terminals.
- Wires should be tightened so that they are held snugly in place, but do not to over-tighten, as this may compress and weaken the conductor.
- Current and voltage inputs must be installed ‘in phase’ for accurate readings (e.g. CT1 on Line 1, CT2 on Line 2)



Figure 5: Leviton solid core CTs

Installing Solid Core CTs

1. Route CT wires through the conduit if not already done.
2. Trim the wire to the appropriate length to avoid coils of excess wiring.
3. Strip wiring to approximately .300 inches and connect to the appropriate terminals as described above.
4. With power turned off, disconnect each monitored conductor and slide on a CT, ensuring the CT is correctly oriented as noted above.
5. Reconnect the conductors.

Failure to install CTs in the correct orientation and on the correct phase will lead to inaccurate meter readings.



Figure 6: Leviton split core CTs

Installing Split Core CTs

1. Route CT secondary wires through conduit if not already done.
2. Trim the wire to the appropriate length to avoid coils of excess wiring.
3. Strip wiring to approximately .300 inches.
4. Connect the CT leads to the appropriate meter as described above.
5. With power to the conductors turned off, place one CT around each conductor, ensuring that the white dot is facing the line side.

Failure to install CTs in the correct orientation and on the correct phase will lead to inaccurate meter readings.

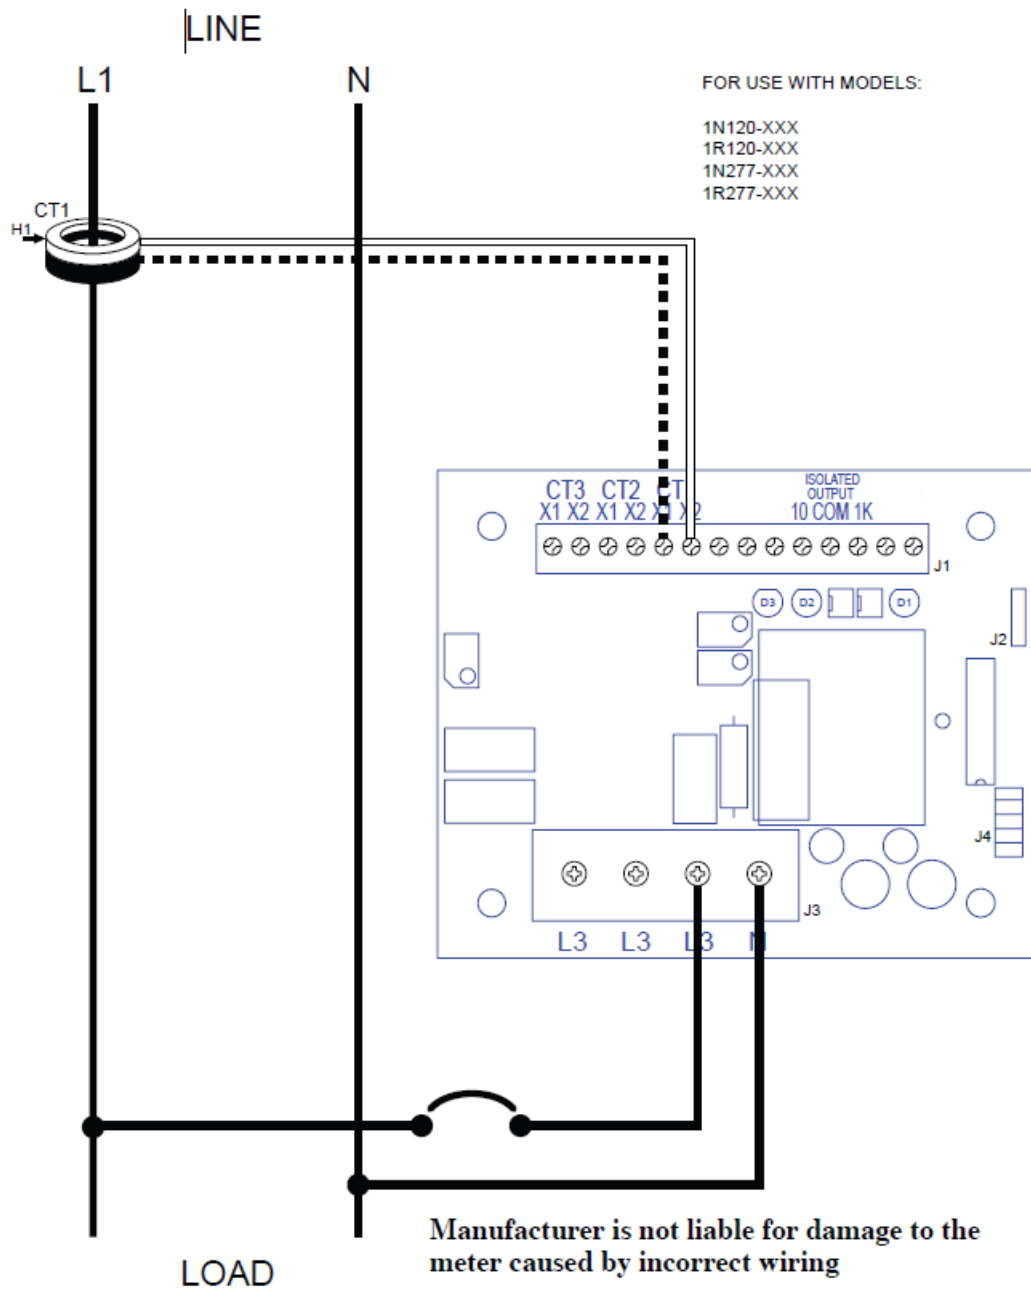


Figure 7: 1-phase, 2-wire Hookup Diagram

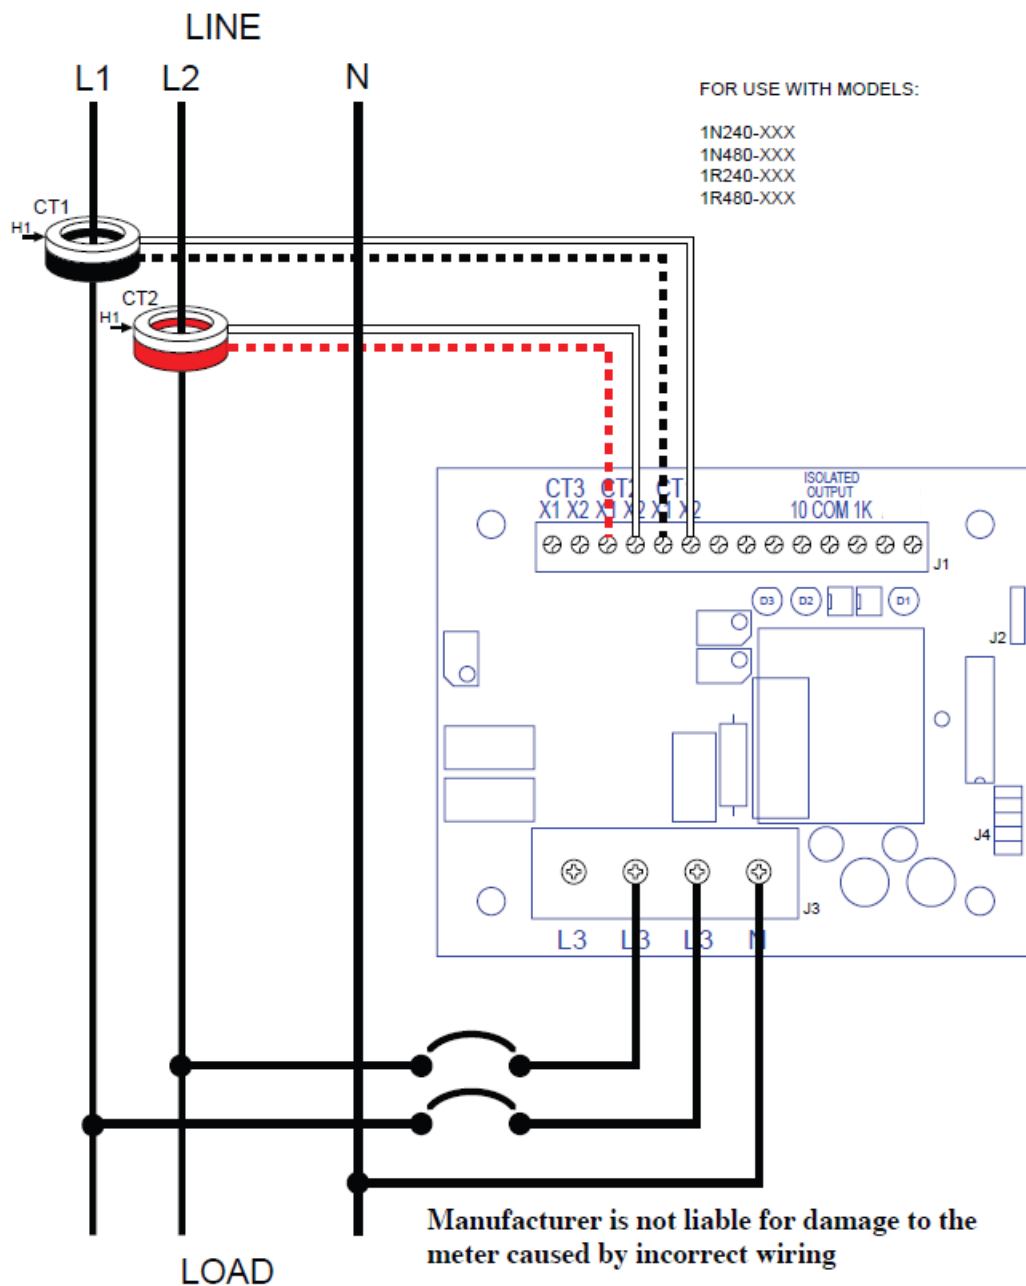


Figure 8: 1 or 2 phase, 3 wire Hookup Diagram

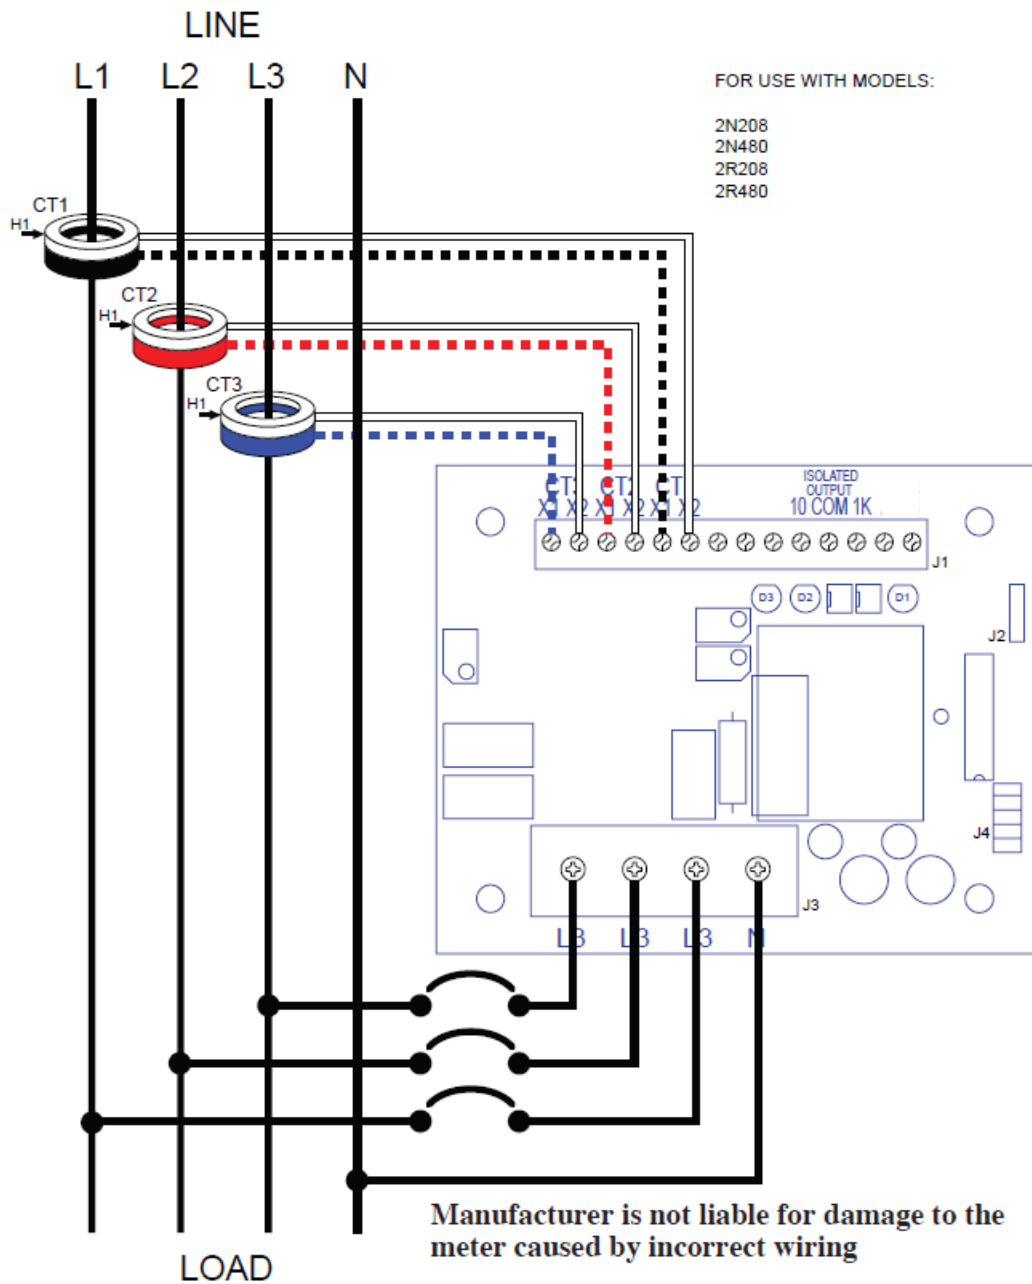


Figure 9: 3-phase, 4-wire WYE Hookup Diagram

3.8 Testing the Installation

Testing Voltage

Voltage should also be tested using an AC Voltmeter to verify that the voltage across voltage line terminals (L1, L2, and L3 to Neutral) is not in excess of the maximum rated voltage.

CT Reverse Phase Indicator

Series 1000 and Series 2000 meters have a red reverse phase indicator LED as described in section 2.3. **There must be a load drawing a minimum of 1 A connected to the meter in order for the reverse phase LED to function correctly.** If this LED is on (with sufficient load), power down the voltage supply and verify that CTs are installed correctly.

Load LEDs

The load LEDs are described in section 2.3. These LEDs should be pulsing at 50% duty cycle when the meter is connected properly and a constant load is applied. Without a proper load, the load LEDs could be on or off.

LCD Display

The Series 1000 and 2000 display is described in Section 2.4. From this description, it is possible to determine if the kWh and/or demand values displayed on the LCD are consistent with the applied load. A load must be applied for the kWh value to show significant changes.

3.9 Securing the Enclosure

In accordance with safety requirements, enclosures must be secured using the provided key lock once installation is complete. The purpose of the lock is to prevent access to live parts that pose potential safety risks. To install the lock, slide through the provided holes on the clamp side of the enclosure and fasten securely.

4. Maintenance

Properly installed meters with sound connections and secure conduit fittings should not require user maintenance. If the meter is functioning abnormally, consult the FAQ/Troubleshooting guide. If the answer cannot be found there, contact Leviton technical support.

5. Troubleshooting/FAQ

<u>Problem</u>	<u>Solution</u>
1. Power LED not illuminated	<ul style="list-style-type: none"> • Check to make sure all connections are wired • Test the voltage being supplied to the meter using an AC voltmeter • With power off, remove any additional line fuses and test with ohmmeter
2. Load LED not flashing	<ul style="list-style-type: none"> • Verify CT connections and orientations • Make sure there is sufficient load to draw a significant current • Test the voltage being supplied to the meter using an AC voltmeter
3. Registered consumption low	<ul style="list-style-type: none"> • Check to make sure the reverse phase LED is not on • Even if the reverse phase light is off, double-check CT orientations. One CT installed in the incorrect direction doesn't always illuminate the reverse phase LED • Make sure that current and voltage connections are in phase • Check power connections and fuses
4. Reverse phase LED illuminated	<ul style="list-style-type: none"> • Verify orientation and connection of CT wires • Ensure that phasing is correct (CT1 on Line 1, CT2 on Line 2) • Verify that a load drawing more than 1 Amp is connected to the meter